


ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE SPECIFIED

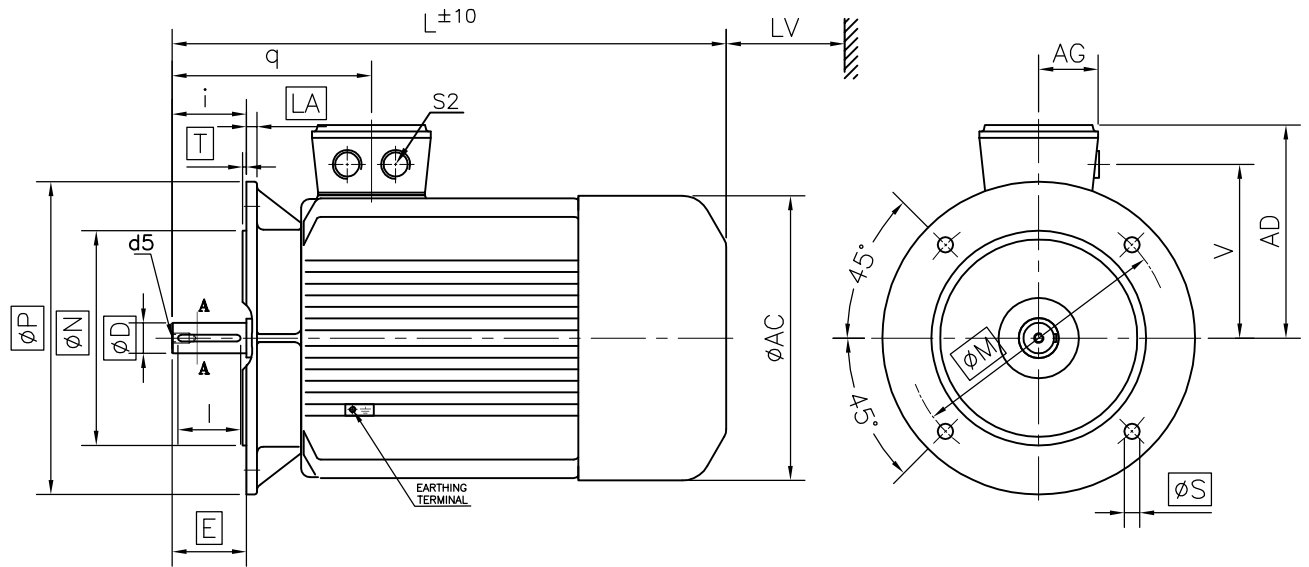


Fixing			General					T box								
IEC Frame	Pole	ØP	ØN	ØM	i	ØS	T	LA	AD	ØAC	L	LV	V	q	AG	S2
90S	2,4,6,8	200	130	165	50	12	3.5	10	140	174	302	35	109	140	52	2x3/4"BSC


Shaft					
ØD	E	F	GA	I	d5
24	50	8	27	45	M8

NOTES:-

- 1) SQUARE ('□') DIMENSIONS ARE AS PER IS:2223.
- 2) 'LV' IS MINIMUM DISTANCE TO BE MAINTAINED FOR EFFICIENT COOLING.
- 3) BODY MATERIAL-ALUMINIUM



SECTION A-A

AMENDMENT								
	Ⓑ	—	DRAWING REVISED FOR STANDARDIZATION				CRJ	05.07.18
	Ⓒ	C/4	BODY MATERIAL ADDED				CRJ	03.05.18
	REV	ZONE	DESCRIPTION				SIGN	DATE
		NAME	DATE	Untolerated dimensions IS:1231 / IS:2223 / IS:2102-1-Very Coarse 	TITLE: DIMENSIONAL DRAWING		W.O.NO.	SCALE NTS
DRN	CRJ	07.04.2018						
CHD	APH	07.04.2018						
APPD	RSA	07.03.2018						
 Bharat Bijlee AIROLI, NAVI MUMBAI					DRG. NO: A09S45111 [Ⓑ]		MOUNTING B5	FR. SIZE 90S
					REF.			