


ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE SPECIFIED


SCALE - N.T.S.

Minimum distance for efficient cooling of motor (To be maintained by user)

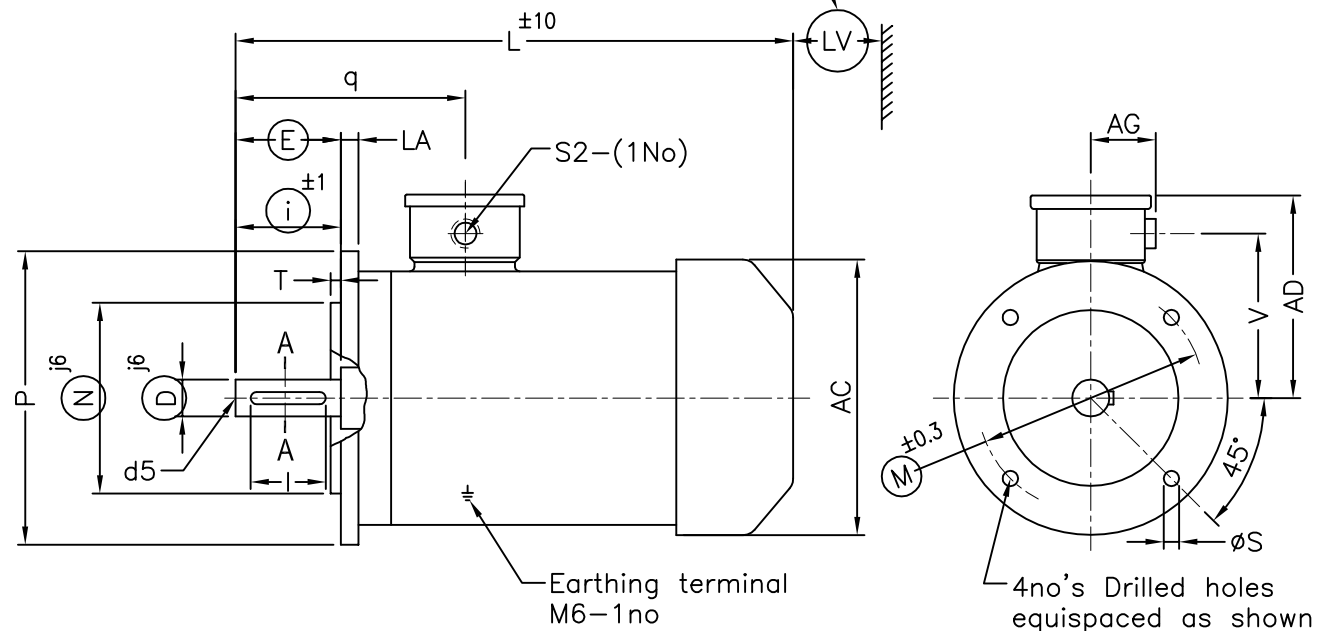

Fixing						General						T box					
IEC Frame	Pole	P	N	M	i	S	T	LA	AD	AC	L	LV	V	q	AG	S2	
71	2,4&8	160	110	130	30	10	3.5	9	124	140	261	30	95	127	40	3/4" BSC	

Shaft					
D	E	F	GA	I	d5
14	30	5	16	25	M5




Notes:-

1. Terminal box can be rotated in 360 deg in steps of 90 deg.
2. Ringed dimensions are as per IS:1231/IEC60072/IS:2223

Customer		Project	
P.O. No.		Consultant	
kW/Pole		Client/Contractor	
Frame		Package	
SO No.		Tag no's	

NAME	DATE	TITLE:
DRN	YCJ	07.04.2015
CHD		
APPD		

Bharat Bijlee
AIROLI, NAVI MUMBAI



DRG. No:

A071451TA