

4

3


2

1

ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE SPECIFIED


SCALE - N.T.S.

Minimum distance for efficient cooling
of motor (To be maintained by user)

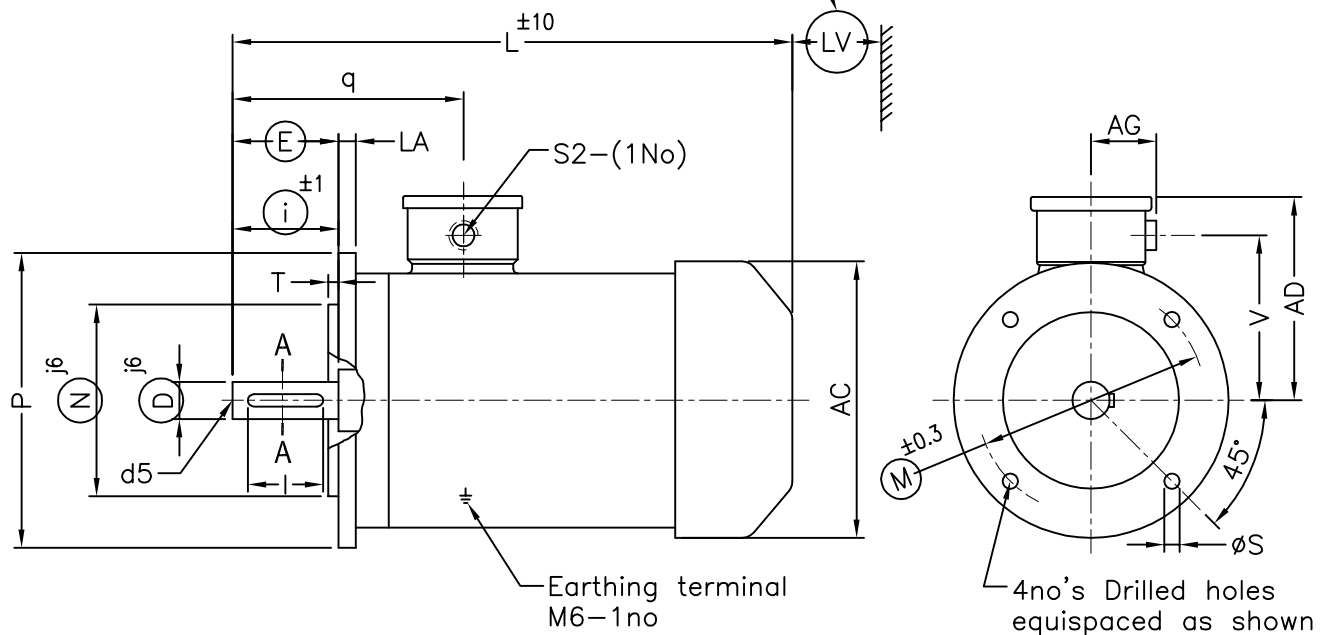

Fixing							General					T box				
IEC Frame	Pole	P	N	M	i	S	T	LA	AD	AC	L	LV	V	q	AG	S2
80	2,4&6	200	130	165	40	12	3.5	10	134	157	267	30	105	112	40	3/4"BSC

Shaft					
D	E	F	GA	I	d5
19	40	6	21.5	35	M6




Notes:-

1. Terminal box can be rotated in 360 deg in steps of 90 deg.
2. Ringed dimensions are as per IS:1231/IEC60072/IS:2223

Customer		Project	
P.O. No.		Consultant	
kW/Pole		Client/Contractor	
Frame		Package	
SO No.		Tag no's	

NAME	DATE	TITLE:
DRN YCJ	07.04.2015	DIMENSION DRAWING
CHD		3PH SQUIRREL CAGE, TEFC (FLANGE MOUNTED) INDUCTION MOTOR (SAFE AREA)
APPD		



DRG. No: **A080451TA**

4

3

2

1