

4

3


2

1

ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE SPECIFIED

SCALE - N.T.S.

Minimum distance for efficient cooling of motor (To be maintained by user)

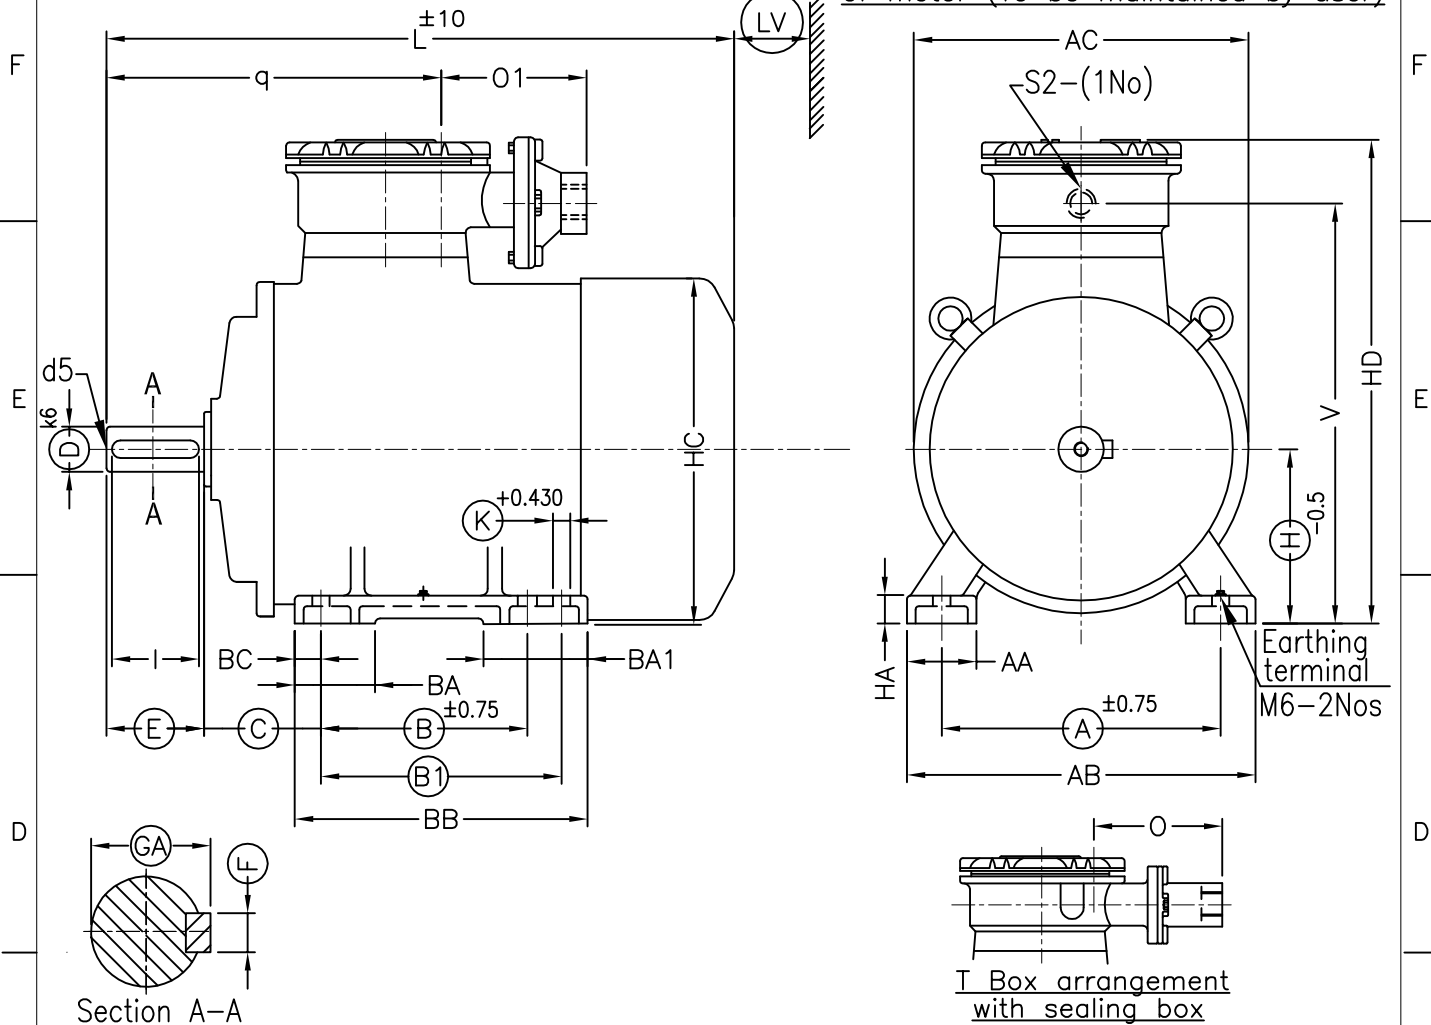

		Fixing							General										
IEC Frame	Pole	A	B	B1	C	H	K	AB	BB	AA	BA	BC	BA1	HA	HC	HD	L	LV	CA
132S/M	2, 4,6&8	216	140	178	89	132	12	256	218	50	53	23	77	17	262	408	551	50	225

T Box					Shaft						
AC	V	O	O1	q	S2	D	E	F	GA	I	d5
260	352	175	100	282	M25x1.5P	38	80	10	41	70	M12


Notes:-

- 1) Ringed dimensions are as per IS:1231/IEC60072
- 2) Terminal box can be rotated in 360 deg in steps of 90 deg.

Customer		Project	
P.O. No.		Consultant	
kW/Pole		Client/Contractor	
Frame		Package	
SO No.		Tag no's	

NAME	DATE	TITLE:
DRN	VDK	
CHD	RBK	
APPD		
		3PH SQUIRREL CAGE, TEFC (FOOT MOUNTED) FLAME PROOF(Ex'd') INDUCTION MOTOR

Bharat Bijlee
AIROLI, NAVI MUMBAI



DRG. No:

D13M40000

4

3

2

1