

4

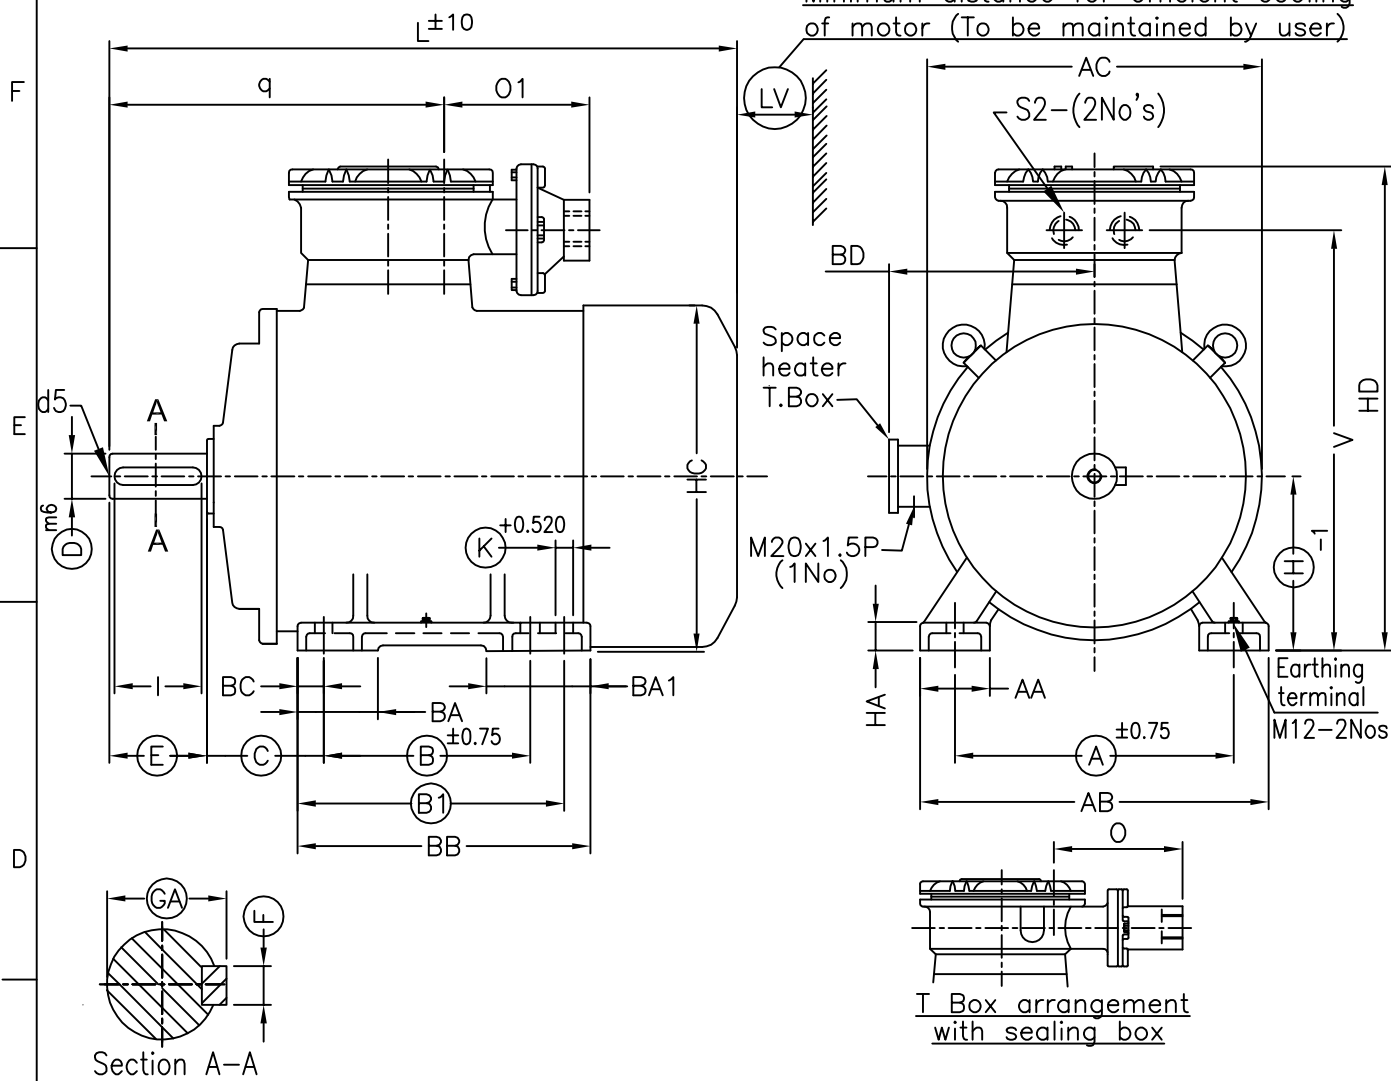
3

2

1

ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE SPECIFIED

SCALE - N.T.S.

Minimum distance for efficient cooling
of motor (To be maintained by user)

Section A-A

T Box arrangement
with sealing box

Fixing

General

IEC Frame	Pole	A	B	B1	C	H	K	AB	BB	AA	BA	BC	BA1	HA	HC	HD	L	LV	AC
315S	4&6	508	406	457	216	315	28	625	540	120	115	46	155	45	617	850	1163	130	606

T Box

Shaft

V	O	O1	BD	q	S2	D	E	F	GA	I	d5
758	276	225	430	614	M63x1.5P	80	170	22	85	160	M20

Notes:-

- 1) Ringed dimensions are as per IS:1231/IEC60072
- 2) Terminal box can be rotated in 360 deg in steps of 90 deg.

Customer		Project	
P.O. No.		Consultant	
kW/Pole		Client/Contractor	
Frame		Package	
SO No.		Tag no's	

NAME

DATE

TITLE:

DIMENSION DRAWING

DRN


YCJ

07.04.2015

CHD

APPD

3PH SQUIRREL CAGE, TEFC (FOOT MOUNTED) FLAME PROOF(Ex'd') INDUCTION MOTOR


Bharat Bijlee
 AIROLI, NAVI MUMBAI


DRG. No:

D31S431TC

4

3

2

1